



ROOF PLANS

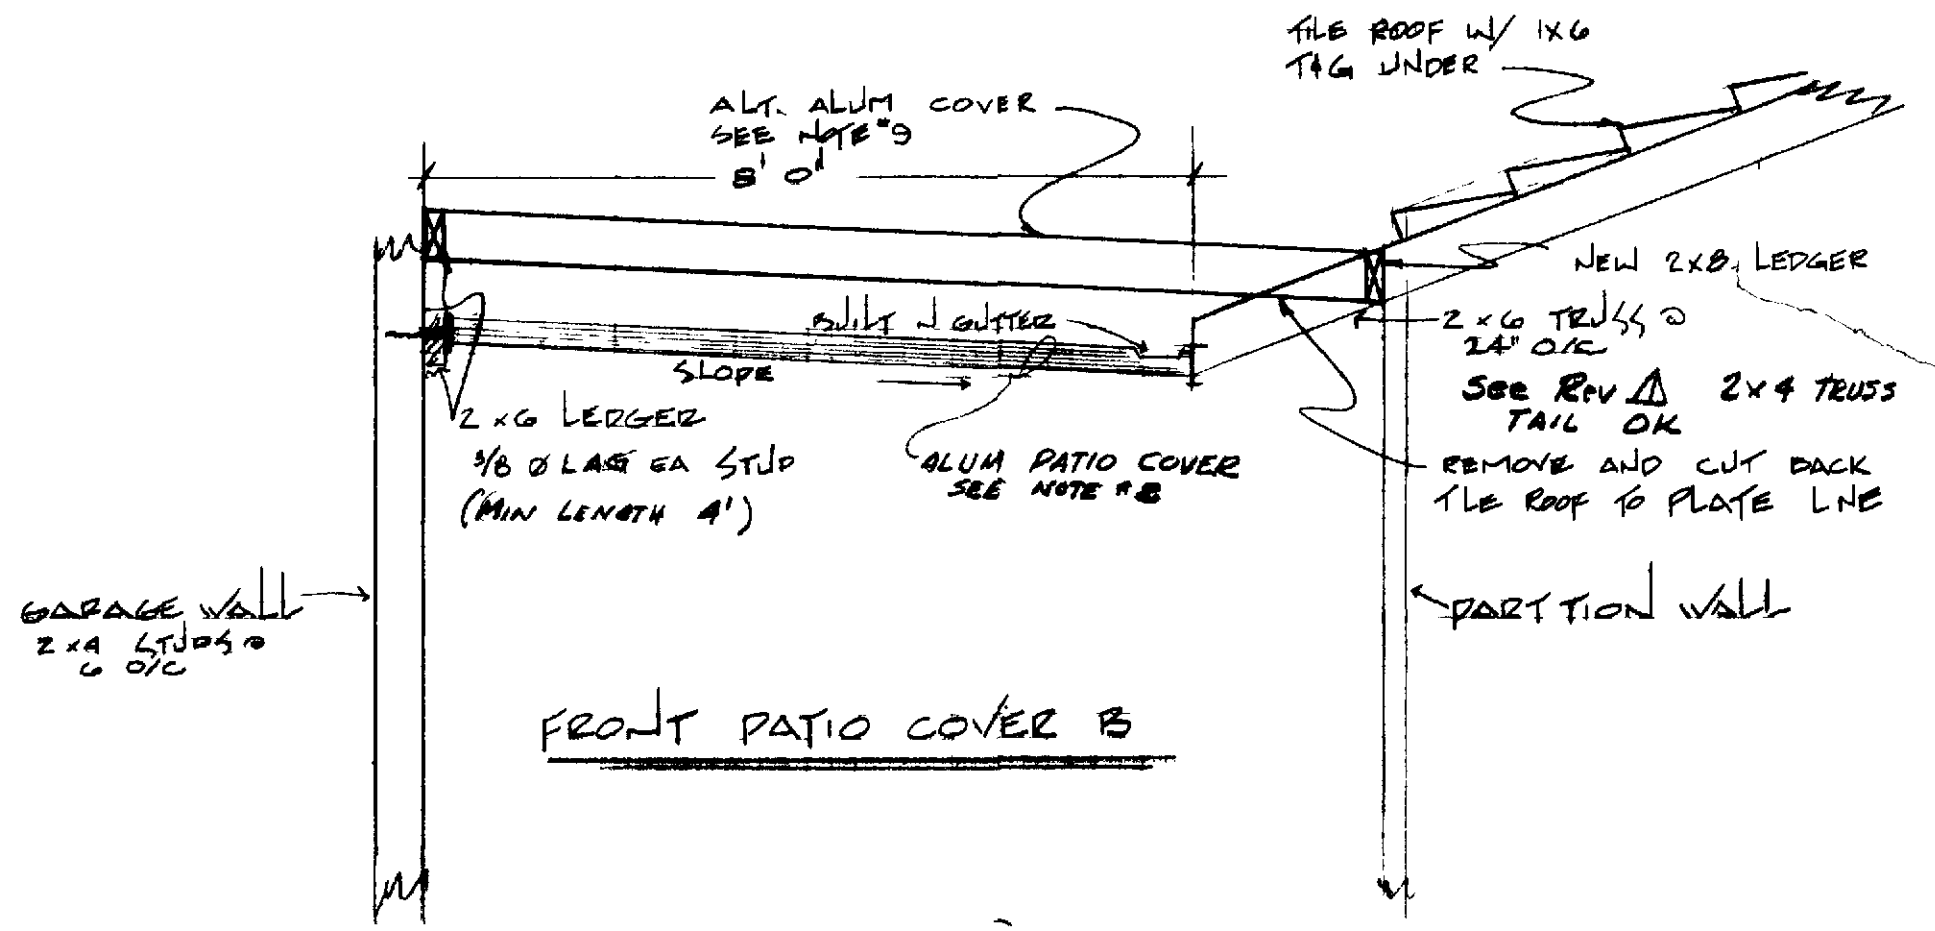

NOTE THERE WILL BE A SPLASHBLOCK AT ALL DOWNSPOUTS
 COLOR OF FACIA TO BE AS CLOSE TO COLOR OF BLDG TRIM AS POSSIBLE IN BAKED ENAMEL

8-3-73 Effort of 2x4 truss to 1'
 $Load = (8)(12 psf)(2) = 96 \# / TRUSS TO 1'$
 $M = (96)(8) + (12+16)(8)(\frac{8}{2}) = 364 \# \text{ say } 3600$
 $f_{2x4} = 3600 \div 8 \text{ OCs} = 450 \text{ psf} > 1500 \text{ OK}$
 $2x4 \text{ roof material} = 1200 \times (15') \times 1500 \text{ ps}$
 $V = 72 + (2)(2)(2) = 184 \# \text{ say } 200$
 $F_v = (1.5)(200) = 300 \text{ psf OK}$
JLS

Rev A EXIST TRUSS TAILS MAY BE 2x4 IN LIEU OF 2x6 IS SHOWN ALL OTHER DETAILS OK
 8-3-73

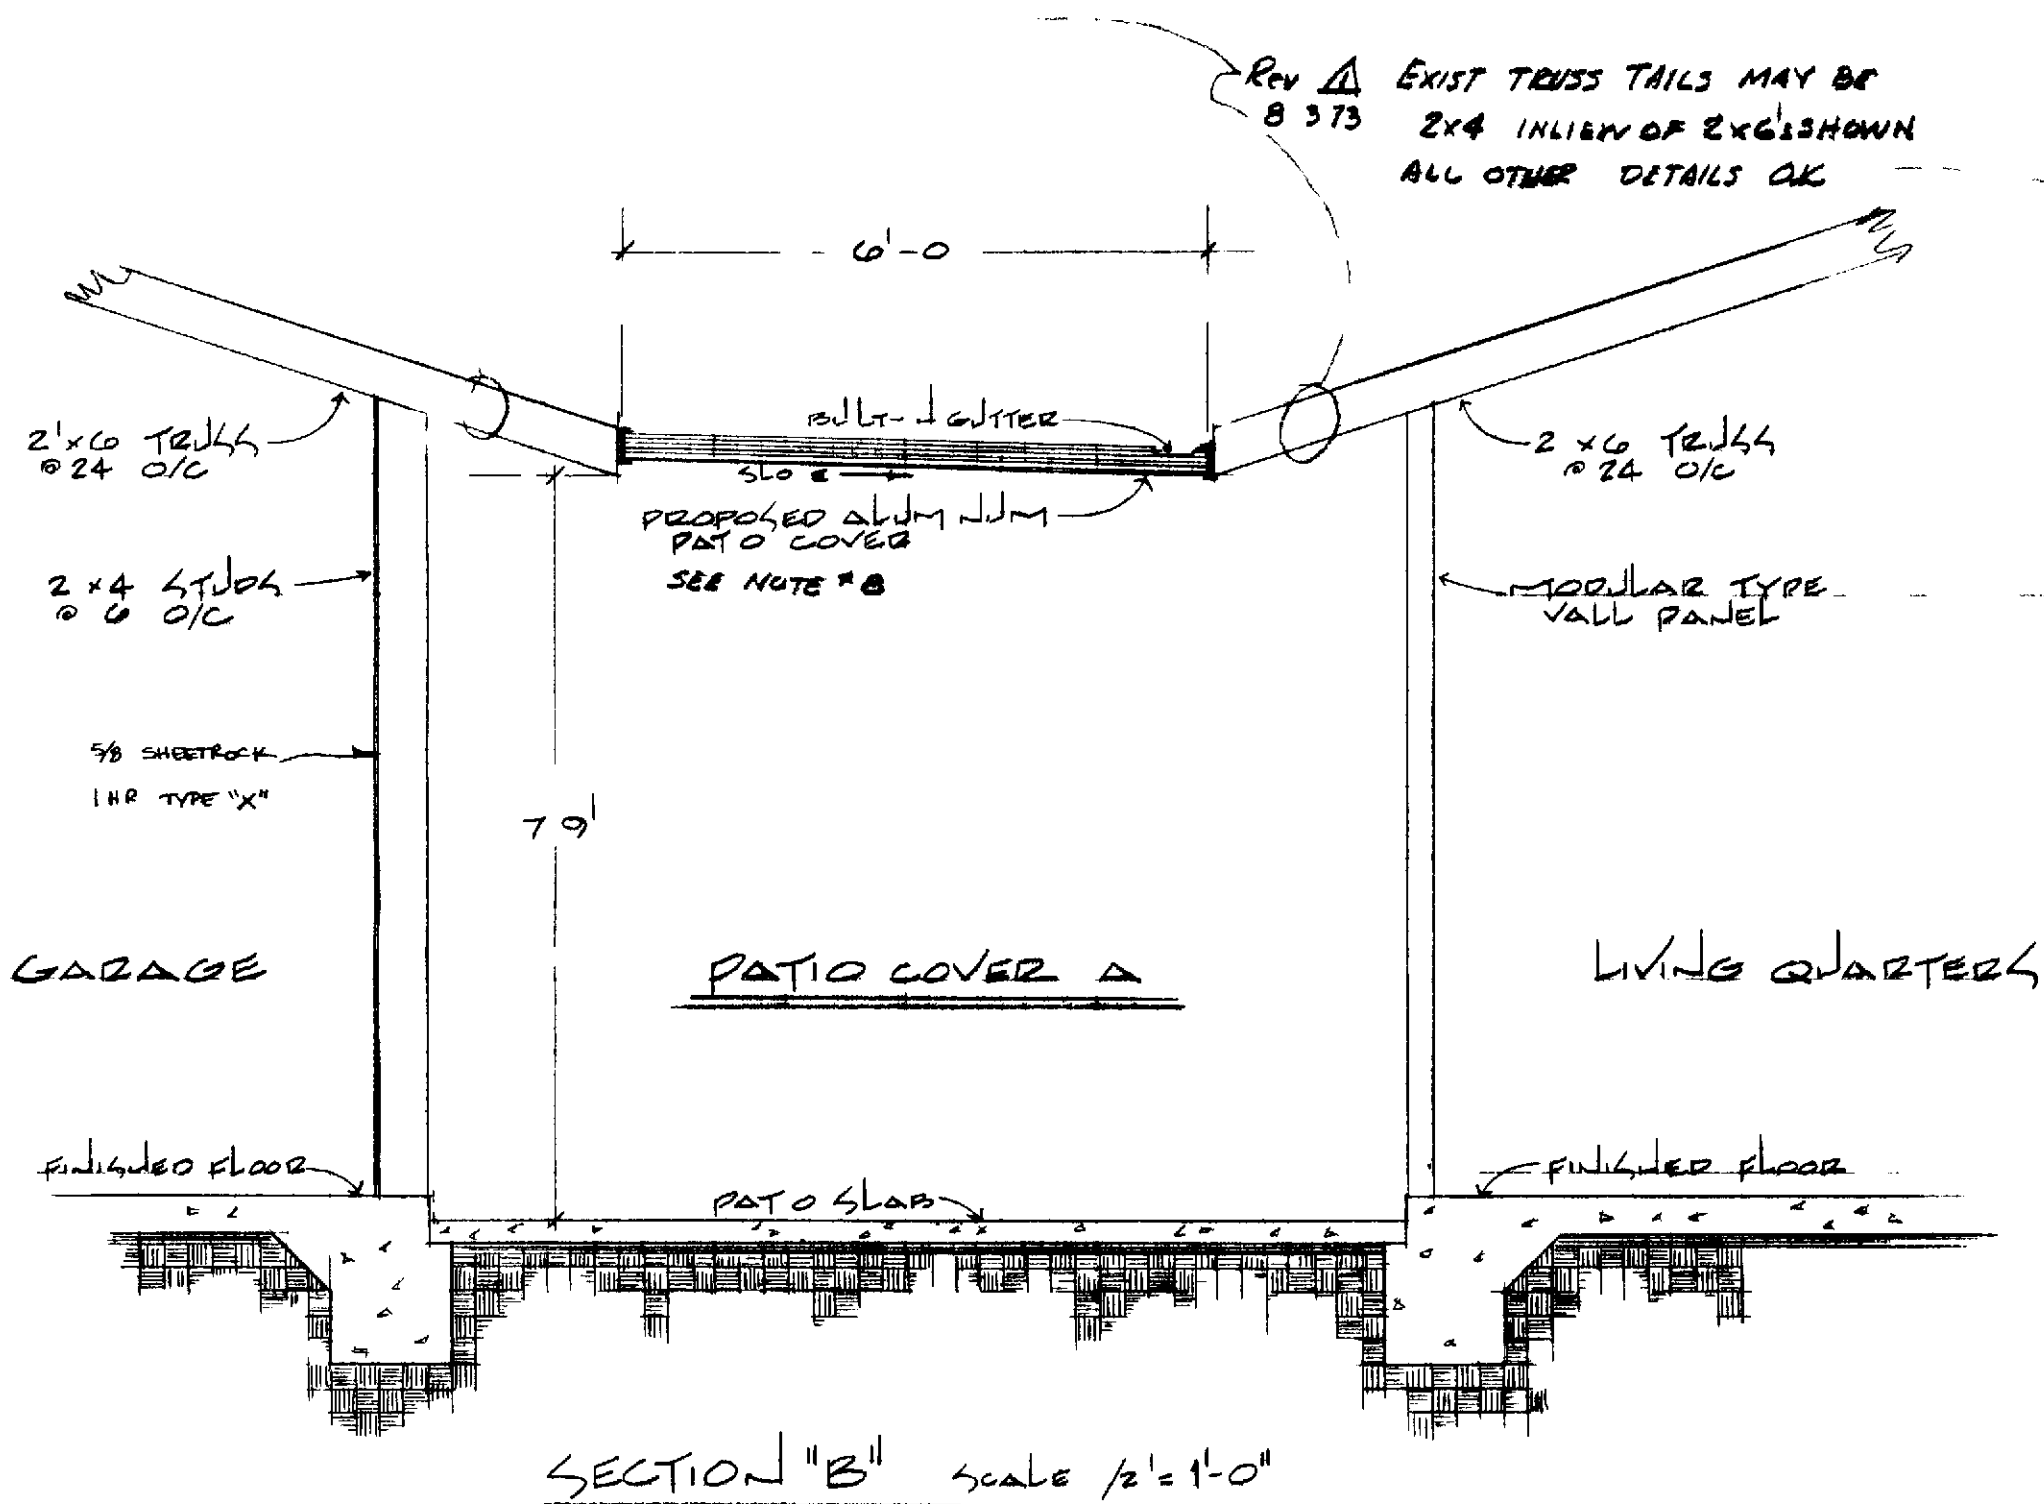


SECTION "B" SCALE 1/2" = 1'-0"

1/4" x 5" WOOD SCREWS @ ALL TRUSS ENDS WHERE NEW PATIO COVER TO BE LOCATED

ADD BLOCK

PATIO COVER CONNECTION BY OTHER BUT SPACING SHALL NOT EXCEED 16" C SEE NOTE # 8

DETAIL OF CONNECTION
 NO SCALE

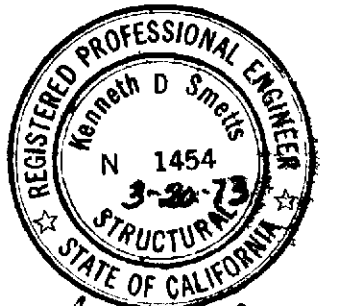

Kenneth D. Smith

PAGE 2 of 2

43 - P-43 - RP-43
 PATIO COVER (ALUMINUM)
 FRONT & REAR

LEISURE WORLD
 STANDARD PLAN
 NUMBER 126

PROFESSIONAL COMMUNITY MET AND APPROVED *Jerry White*

PCM INC 380-4616
 POB 2220 LAGUNA HILLS

MARCH 73

SEE PAGE 1 PLAN 70-301 FOR GENERAL NOTES